

INSTRUMENT TRANSFORMERS

Exclusively Distributed by:
MONTRELEC INC.



**INSTRUMENT
TRANSFORMERS
OUTDOOR TYPES**

OPERATION CONDITIONS FOR POTENTIAL TRANSFORMERS

1. When the secondary terminals are connected to the measuring or protection devices, one of the terminals should be earthed for safety as seen in **FIGURE VT-1**
2. The base plate must be earthed.
3. The secondary circuits must not be short-circuited during operation. Otherwise the voltage transformers will be thermally destroyed.
4. If any of the secondary windings of a voltage transformer, used for the purpose of measuring, will not be used then it must be left open with one terminal connected to earth as seen in **FIGURE VT-2**. However, even if the open-delta windings are not to be used for detection of earth faults, they must be connected in an open delta circuit and an appropriate resistor (depending on the voltage and thermal power rating of the secondary) must be connected and open-delta circuit must be earthed only at one point as seen on **FIGURE VT-4**. Please refer to the technical recommendations below.
5. For single phase transformers, the neutral terminal of the primary " N " must be earthed in the earthed (neutral) systems as seen in **FIGURE VT-3**

Other important points and notes

When using single pole insulated inductive voltage transformers, it is very important to be aware that, if a circuit is being closed or during the decaying period of an earth fault, ferroresonance may occur.

Ferroresonance can lead to the overheating and thermal destruction of the voltage transformer or high levels of voltages may be induced. In general, ferroresonance can be eliminated by the use of an appropriate resistor. The resistor is placed as a burden in open-delta circuit formed by three voltage transformers delta windings. The open-delta circuit must always be earthed only at one point as seen in **FIGURE VT-4**. The open-delta connection can also be used for earth-fault monitoring with appropriate devices.

As the number of cable systems is increasing in the energy distribution systems, the protection of voltage transformers have become very important for the uninterrupted operation of the system without any failure and/or down time. For that reason, ALCE is always recommending the use of open-delta windings in single phase inductive voltage transformers.

The use of open-delta windings may not be sufficient for the protection of voltage transformers by itself in some cases. An energy systems design engineer shall always use proper surge arresters, avalanche diodes, limiters and/or their combinations for the survivability of the distribution system after a fault or disturbance.

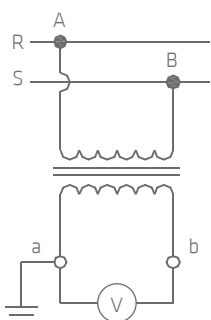


FIGURE VT-1




FIGURE VT-3




FIGURE VT-2

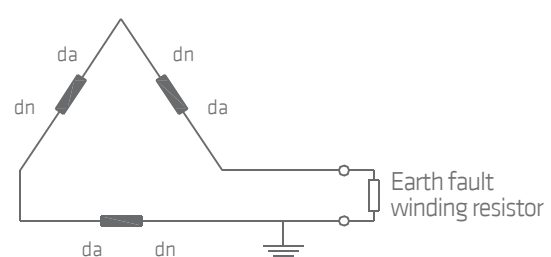


FIGURE VT-4

OUTDOOR VOLTAGE TRANSFORMERS SINGLE POLE



12-17,5- 24 kV
Block Type Design
Single Pole Insulated
Outdoor Application

Standard: IEC 61869-3 / ANSI /
GOST / VDE

Exclusively Distributed by:
MONTRELEC INC.


TECHNICAL DATA

Type		VH24	VH36
Rated data			
Highest voltage for equipment, Um (r.m.s) (Max.)	(kV)	3.6 -7.2 - 12- 17.5 - 24	36
Test voltage	(kV)	10/40, 20/60, 28/75, 38/95, 50/125	70 /170
Rated frequency	(Hz)	50 or 60	50 or 60
Rated primary voltage, Un	(kV)	3,3 ... 24/ $\sqrt{3}$	30 ... 36/ $\sqrt{3}$
Secondary voltage	(V)	100/ $\sqrt{3}$... 120/ $\sqrt{3}$	100/ $\sqrt{3}$... 120/ $\sqrt{3}$
Rated burden in class 0.2 - 0.5 - 1.0	(VA)	Max.150	Max.150
Maximum unrated burden for protection purpose in class 3P/6P	(VA)	100	100
Thermal limiting current for earth fault detection winding	(A)	6	6
Rated voltage factor	(8h)	1,9 Un	1,9 Un

OUTDOOR
VOLTAGE TRANSFORMERS
SINGLE POLE

07

DIMENSIONS

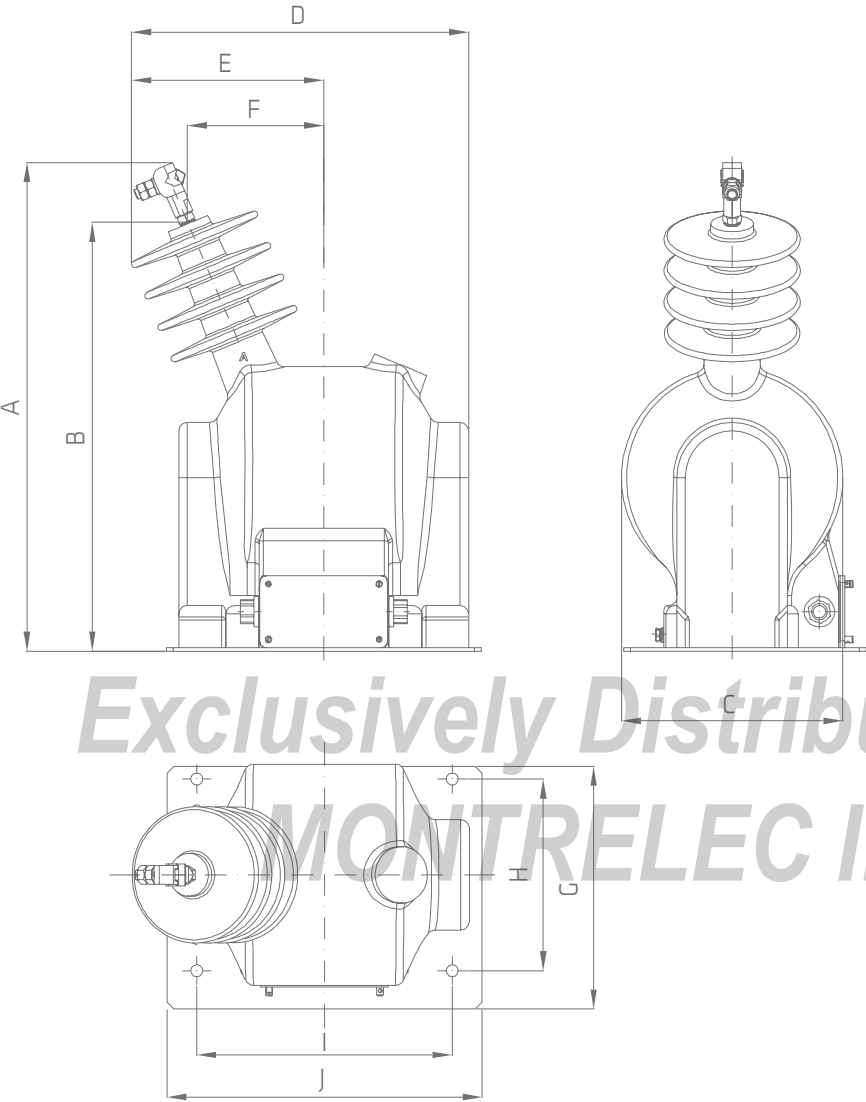

Exclusively Distributed by:
MONTRELEC INC.

Type	VH24	VH36
Dimensions (mm)		
A	574	672
B	504	606
C	260	280
D	396	479
E	226	294
F	160	225
G	285	285
H	225	225
I	300	300
J	370	370

OUTDOOR VOLTAGE TRANSFORMERS DOUBLE POLE



36 kV
Block Type Design
Double Pole Insulated
Outdoor Application

Standard: IEC 61869-3 / ANSI /
GOST / VDE

Exclusively Distributed by:
MONTRELEC INC.


TECHNICAL DATA

Type		2VH24	2VH36
Rated data			
Highest voltage for equipment, Um (r.m.s) (Max.)	(kV)	3.6 - 7.2 - 12 - 17.5 - 24	36
Test voltage	(kV)	10/40, 20/60, 28/75, 38/95, 50/125	70 / 170
Rated frequency	(Hz)	50 or 60	50 or 60
Rated primary voltage, Un	(kV)	3,3 ... 24	30 ... 36
Secondary voltage	(V)	100 ... 120	100 ... 120
Rated burden in class 0.2 - 0.5 - 1.0	(VA)	Max. 150	Max. 150
Maximum unrated burden for protection purpose in class 3P/6P	(VA)	–	–
Thermal limiting current for earth fault detection winding	(A)	–	–
Rated voltage factor	(8h)	1,2 Un	1,2 Un

OUTDOOR
VOLTAGE TRANSFORMERS
DOUBLE POLE

09

DIMENSIONS

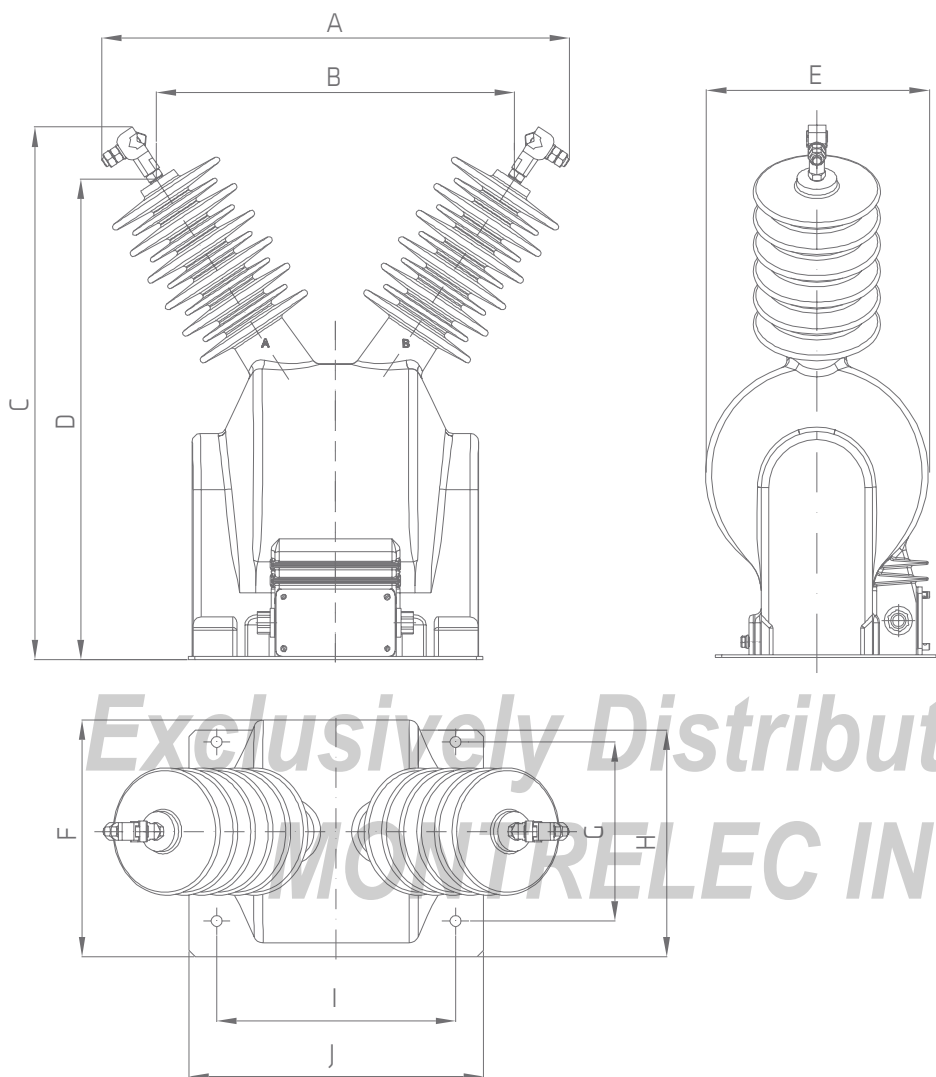

Exclusively Distributed by:
MONTRELEC INC.

Type	2VH24	2VH36
Dimensions (mm)		
A	446	587,5
B	320	450
C	574	672
D	504	606
E	260	280
F	287,5	297,4
G	225	225
H	285	285
I	300	300
J	370	370